




HIGH EFFICIENCY HEAT SINKS

FOR ALL STANDARD SERIES 1 SIZE SOLID STATE RELAYS


MATERIAL: ALUMINUM • FINISH: ANODIZED

50TH
ANNIVERSARY

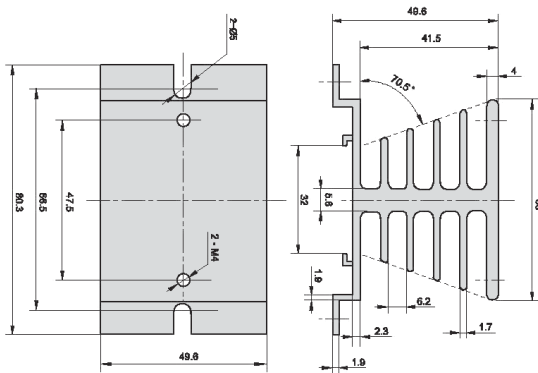


15 AMP HEAT SINK
PART# HS-1\$9.75

ISO-9001
MANUFACTURED IN A
QUALITY SYSTEM CERTIFIED
FACILITY.

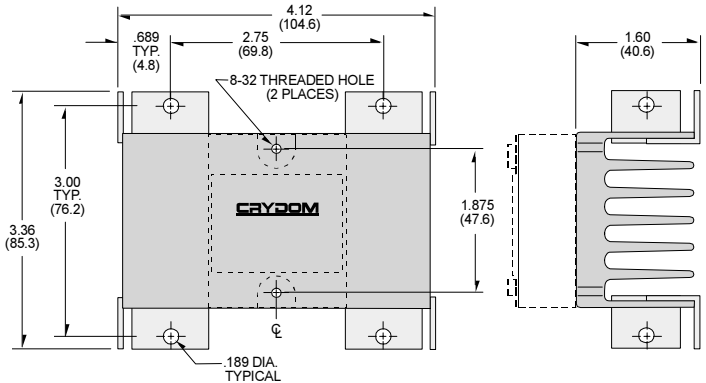


25 AMP HEAT SINK
PART# HS-2 \$19.00

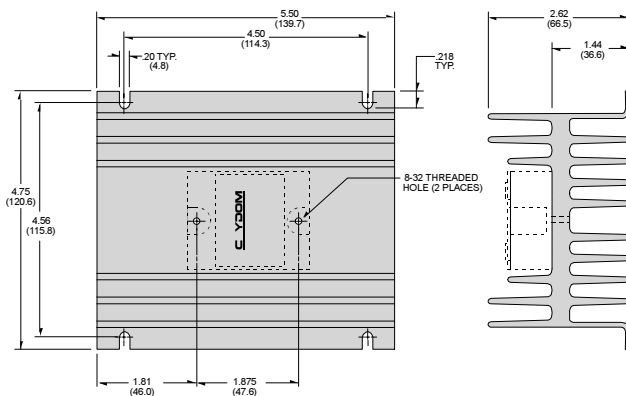

40 AMP HEAT SINK
PART# HE-54 \$29.00

NOTE: ALWAYS USE HEAT
SINK COMPOUND BETWEEN
RELAY AND HEAT SINK FOR
PROPER HEAT DISSIPATION.

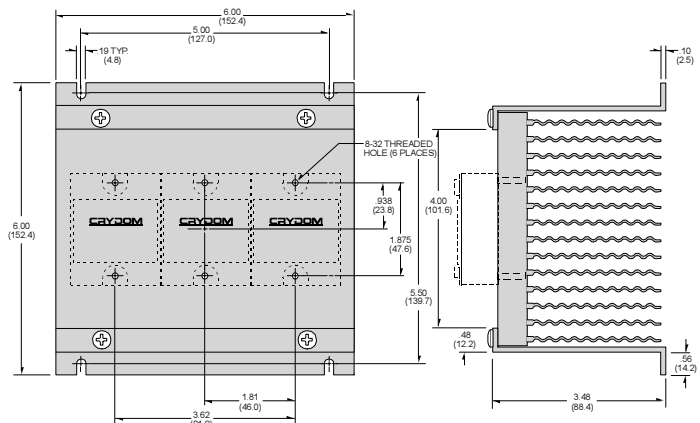

90 AMP HEAT SINK
PART# HE-90 \$96.90

SILICONE HEAT SINK COMPOUND

Apply a thin layer (more is not better) of Heat Sink Compound between the metal back plate on your solid state device and the heat sink for maximum heat dissipation.



PART #DC-340
4oz. TUBE

1-3	4+
\$13.25	\$12.75

PLEASE READ: IMPORTANT NOTES ON PANEL MOUNTING OF SOLID-STATE RELAYS.

To avoid overheating and possible damage to the relay's circuitry, care must be taken to provide adequate heat dissipation. NEVER OPERATE A SOLID-STATE POWER RELAY IN FREE AIR OR WITHOUT A PROPER HEAT SINK.

Make sure that the mounting surface is clean, and free of paint or oxidation. If mounting to a metal surface, apply a very thin layer of Heat Sink Compound onto the relay's metal mounting plate. Take care to use proper torque when tightening the mounting screws.

Under normal operating conditions, the relay's case temperature should not exceed 113°F (45°C). Additional heat sinking or a cooling fan must be provided if the relay's operating temperature exceeds its optimum rating under load. Where there is any question about the relay's ability to maintain a normal operating temperature, a higher current relay should be specified.



PLASTIC PROCESS EQUIPMENT, INC.

8303 CORPORATE PARK DRIVE
MACEDONIA, OHIO 44056-2300
216-367-7000 • FAX: 216-367-7022
TOLL FREE: 800-321-0562

6385 MONTESSOURI STREET
LAS VEGAS, NEVADA 89113-1186
702-433-6385 • FAX: 702-433-6388
TOLL FREE: 800-258-8877

www.ppe.com

e-mail: sales@ppe.com

Toll Free: USA, Canada & Mexico

800-362-0706

Order Fax: 800-223-8305